



**WATER DEPARTMENT**

180 N.E. 2<sup>nd</sup> Street  
Hermiston, OR 97838

**BACKFLOW INQUIRIES**

**Phone: 541-667-5072 Fax: 541-567-6731**

ALL OTHER INQUIRIES 541-567-5521

May 20, 2015

---

## **NOTICE OF TESTING REQUIREMENT FOR CUSTOMERS**

---

PERIODIC TEST AND MAINTENANCE REPORT  
of  
Backflow Prevention Device

If you have a water backflow prevention device(s) installed at this location it is due for its annual test, as required by **State of Oregon Health Division Rules Chapter 333-061-0070, subsections 1 thru 12**. This may be the first time you have ever received a notice for your backflow device to be tested. Due to State Of Oregon Rules, you are **required** to have your backflow device tested yearly and submit those results to the City of Hermiston.

Please have the device tested by a State of Oregon certified Backflow Device Tester. You can find a listing of testers on the State's website at:

<https://yourwater.oregon.gov/backflow.php>


We need the device results back by **September 30<sup>th</sup>, 2015**. Upon completion of a test showing the device to be operating properly, a copy of the test results need to be forwarded to the **Water Department at 180 NE 2<sup>nd</sup> St.** In the event that you have completed the required testing for **2015**, please forward the tests results and disregard this letter.

Additional information relative to this matter, examples, questions & answers may be obtained on City of Hermiston's website at <http://www.hermiston.or.us/water/backflow>. You may also contact us by phone or writing to the City of Hermiston Water Department at the address & number listed at top.

Sincerely,

HERMISTON WATER DEPT.


## EXAMPLES OF TYPICAL BACKFLOW PREVENTER INSTALLATIONS

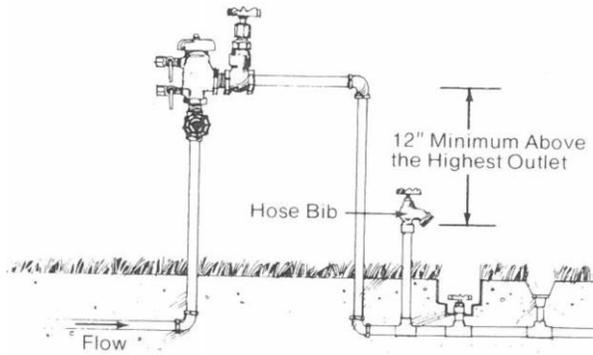

### **PRESSURE VACUUM BREAKER**

These are typically **found near a house or building** and will be above ground at highest point on lot. This installation shows a sprinkler system application.

Typical applications would be for irrigation sprinklers.

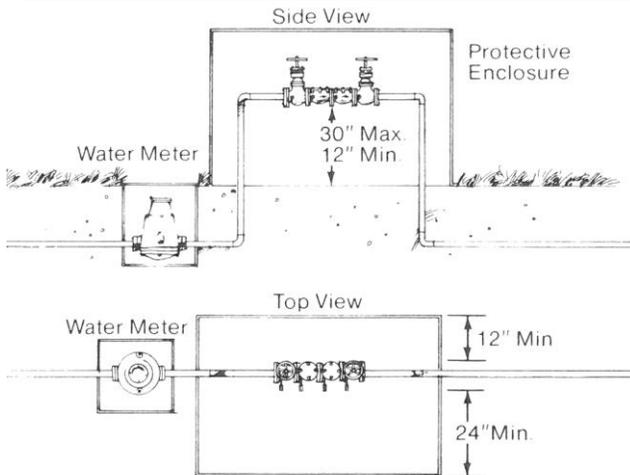


### **DOUBLE CHECK /DOUBLE DETECTOR CHECK VALVE**

These are typically **found near the water meter box, placed above or below the surface in a vault/box, in garages or mechanical rooms.**

Typical applications would be:

Irrigation sprinklers, pools, hot tubs, schools, multi-family housing, hotels, motels, supermarkets, restaurants, mini-marts, soda pop dispensers

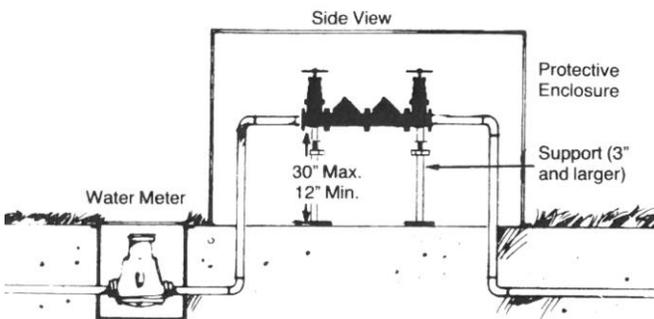

### **REDUCED PRESSURE BACKFLOW ASSEMBLY**

These are typically **above ground in an insulated box or in a mechanical/maintenance room.**

Typical applications would be for car washes, breweries, industrial plants, laboratories, laundries, wells, concrete plants, medical/dental facilities

Certification Number	Name of Tester	Phone Number	Employer	Address
3931	Nathan Carper	541-938-5451	CARTER PLUMBING INC	Po Box 705; Milton Freewater, OR 97862
4209	Randy Collier	541-561-7078	MECHANIX INC	741 W Sandpiper Ave; Hermiston, OR 97838
6074	Aaron Davis	541-720-0486	C & G BACKFLOW TESTING	266 E Grouse Ct; Hermiston, OR 97838
4188	Daniel Deist	541-276-5945	MCLAUGHLIN LANDSCAPE	1160 Tutuinla Rd; Pendleton, OR 97801
5504	Craig Farley	541-278-2800	PENDLETON PLUMBING LLC	1802 Sw Emigrant Ave; Pendleton, OR 97801
4625	Michael Ledbetter	541-701-0288		80184 Rivera Ln; Hermiston, OR 97838
6072	Matthew Menchaca	541-567-8660	TERRA VERDE LANDSCAPE	660 Ne North St; Hermiston, OR 97838
5943	Matthew Morris	541-276-7221	ROB MERRIMAN Plumbing	4354 Westgate; Pendleton, OR 97801
6097	Steven Peterson	541-571-7080		607 E Autum Ave; Hermiston, OR 97838
6131	Christopher Thomas	541-969-4444		112 Se Goodwin Ave; Pendleton, OR 97801
5500	Zackary Wagoner	541-571-0763	ROUND-UP CITY PLUMBING	1113 Se Alexander Ave; Pendleton, OR 97801
4334	Michael Woolfolk	541-276-7221	ROB MERRIMAN PULMBING & HTG INC	4354 Westgate; Pendleton, OR 97801